



STAND-ALONE CURB

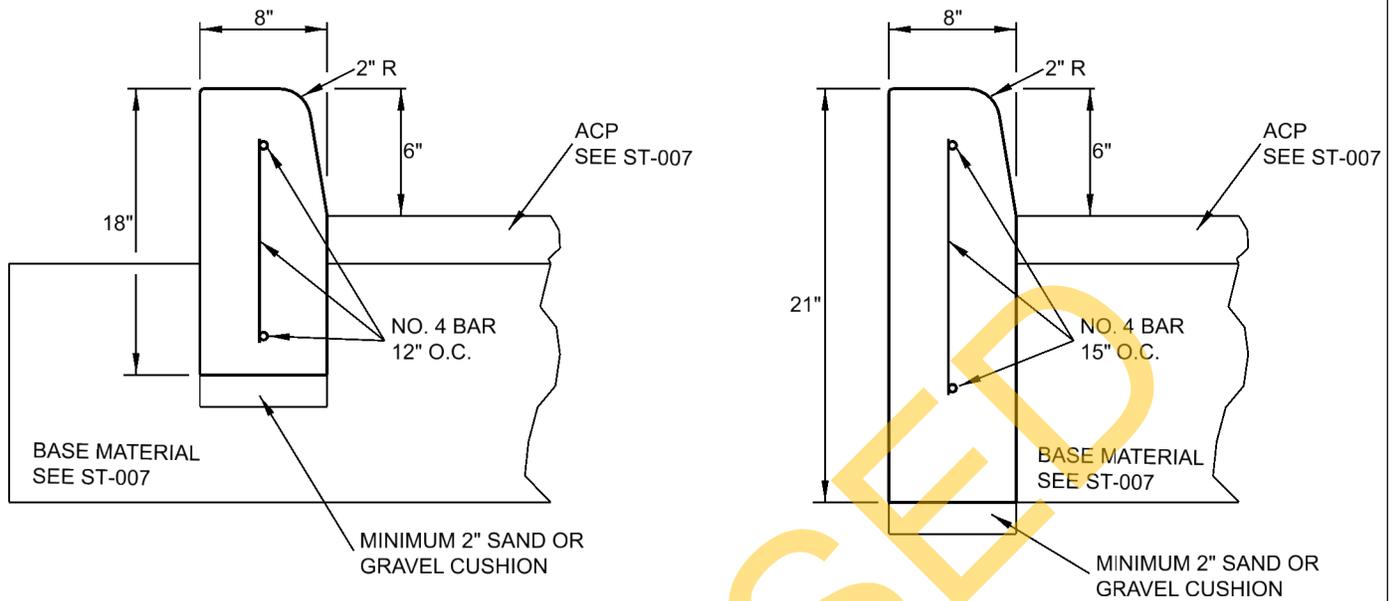

COLLECTOR STREET

LOCAL STREET

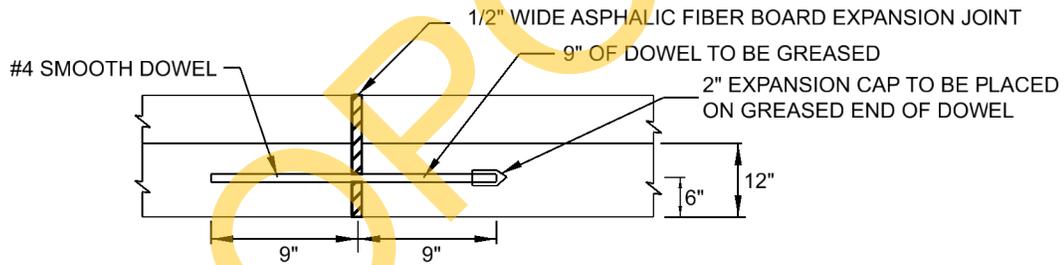

LONGITUDINAL SECTION THRU CURB SHOWING TYPICAL EXPANSION JOINT DETAILS.

REINFORCING STEEL SHALL NOT CROSS EXPANSION JOINTS.
STEEL SHALL BE TERMINATED 3" (+ OR -) 1" FROM FACE OF THE JOINT.

NOTES:

1. REINFORCING BARS SHALL BE LAPPED A MINIMUM OF 18".
2. CURB SHALL HAVE FORMED TOOLED OR SAWED CONTRACTION JOINTS AT + 10'. THE DEPTH OF THESE JOINTS SHALL BE SUFFICIENT TO ENSURE CRACKING AT THE JOINTS.
3. CURB SHALL HAVE EXPANSION JOINTS AT POINTS OF CURVATURE, AT INTERVALS NO GREATER THAN 100' AND AT ALL ADJACENT STRUCTURES.
4. UNLESS OTHERWISE SHOWN, TRANSITIONS BETWEEN CURBS OF DIFFERING CROSS SECTION SHALL BE ACCOMPLISHED OVER A 10' LENGTH OR AS APPROVED BY THE CITY ENGINEER.
5. ALL CONCRETE TO BE CLASS "A" 3000 PSI CONCRETE.
6. ALL EXPOSED CONCRETE SURFACES TO BE BRUSHED SMOOTH AND UNIFORM.

8/25/2023 3:47:01 PM \\files\Departments\Public Works\Street_Typical_Sections\ST-013a_curb.dgn



ENGINEERING DIVISION

STANDARD CONSTRUCTION DETAIL

SCALE: N.T.S.

APPROVED DATE:

STANDARD NO: ST-013a