



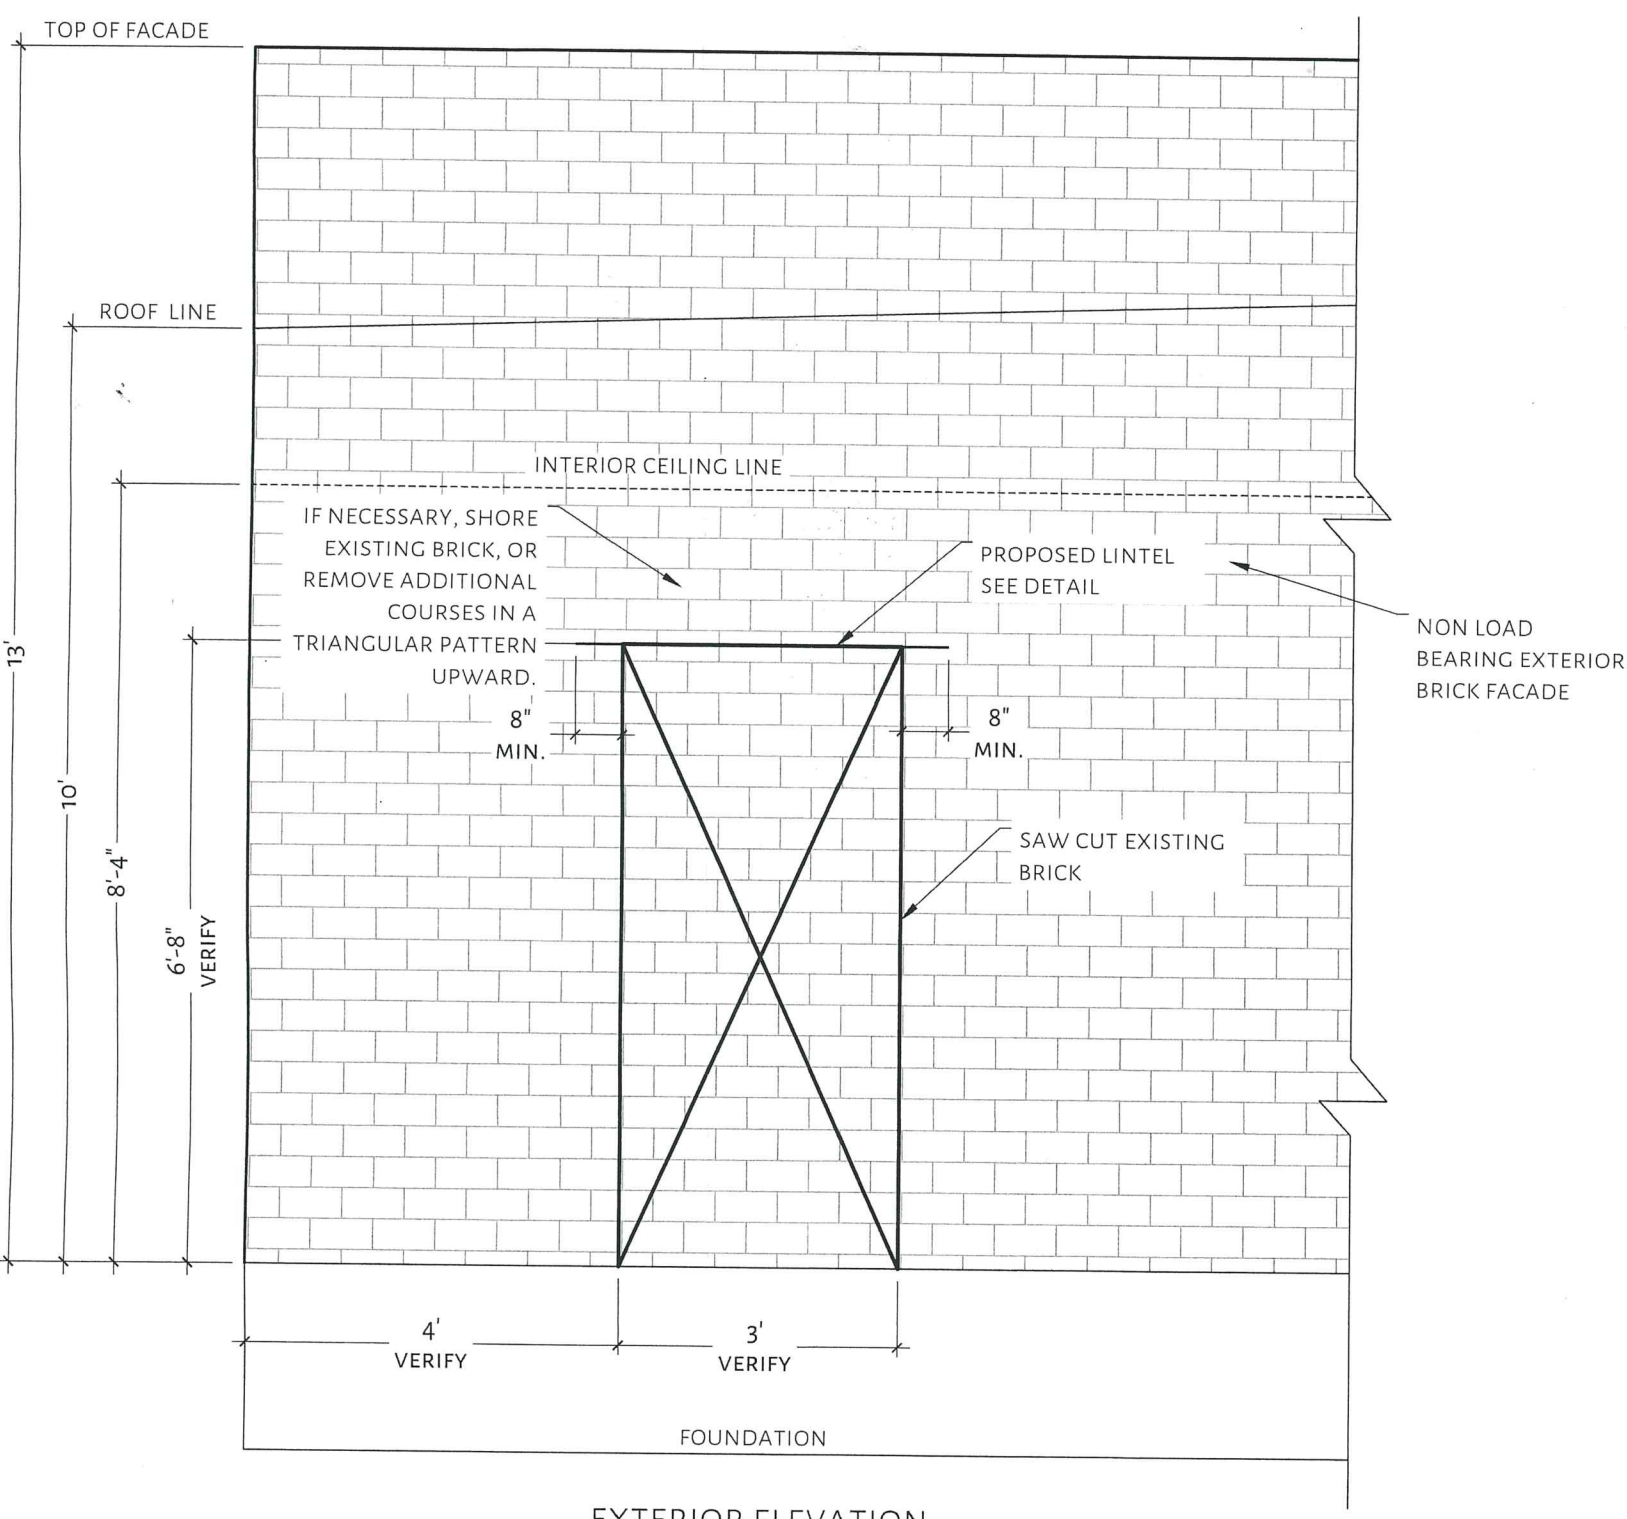

EXTERIOR ELEVATION
SCALE: $\frac{3}{4}" = 1'$

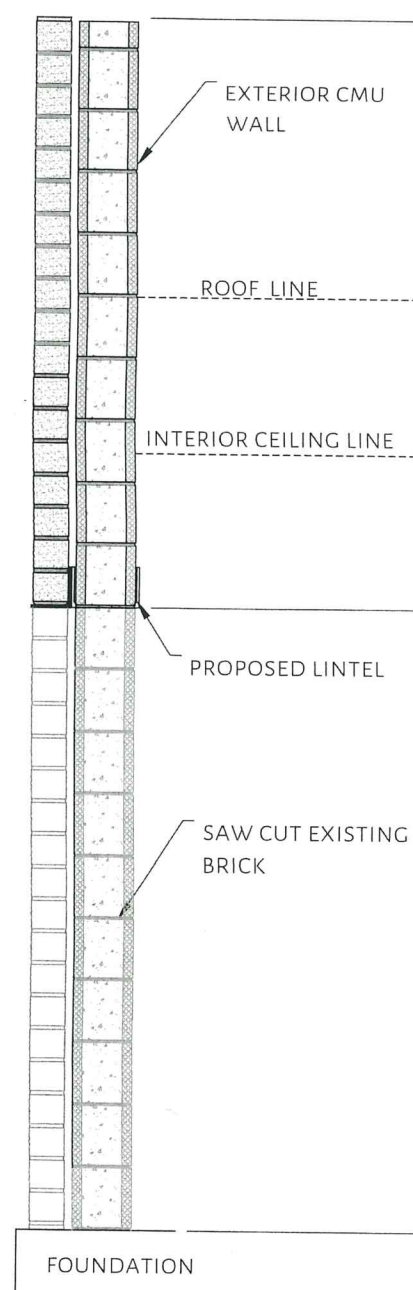

WALL SECTION
SCALE: $\frac{3}{4}" = 1'$

STEEL LINTEL SCHEDULE		
SIZE	CLEAR OPENING	
	GREATER THAN	UP TO
L 4 X 3 X $\frac{3}{8}$	-	6'-0"
L 6 X 4 X $\frac{3}{8}$	6'-0"	11'-0"
L 7 X 4 X $\frac{3}{8}$	11'-0"	12'-0"
L 8 X 4 X $\frac{1}{2}$	12'-0"	14'-0"

NOTES:

1. PROVIDE ONE MEMBER FOR EACH 4" NOMINAL WIDTH OF MASONRY.
2. INSTALL ALL LOOSE LINTELS WITH LONG LEG VERTICAL.
3. PROVIDE TEMPORARY SHORING FOR ALL LINTELS UNTIL GROUT HAS SET.
4. ANGLE SIZE IS MINIMUM.
5. ALL LINTELS SHALL HAVE 8" MINIMUM END BEARING.
6. DEFLECTION IS LIMITED TO $L/600$

BRICK/STONE VENEER

CMU EXTERIOR WALL

AIR GAP

FLASHING

STEEL LINTEL, SEE SCHEDULE

1" TYP.

DOUBLE LINTEL, L 4 X 3 X $\frac{3}{8}$

FILLED CELLS

CMU BLOCK

(2) #5 BARS

ALTERNATE CMU LINTEL

NOTES:

1. MINIMUM BEARING LENGTH OF 8" EACH SIDE.
2. EACH COURSE SHALL HAVE (2) #5 BARS CONTINUOUS.

1


LINTEL DETAIL

NTS



**LONE STAR
STRUCTURAL, LLC**
WWW.LONESTARSTRUCTURAL.COM | TEXAS REGISTERED FIRM F-20642 | P: 214-251-3131

ELKS LODGE 2279
353 S. SEGUIN AVE
NEW BRAUNFELS, TEXAS



JOB: 2513ELKS
DATE: 24 APRIL 2025
DRAWN: JW
EXT. DOC
SHEET: 1
S